
DRAINING.

1. NEW DVR EQUIPMENT SHALL BE SUITABLY GROUNDED PER NEC 250.

Figure 6

ST. ST. STAINLESS STEEL



DRAINING.

1. NEW DVR EQUIPMENT SHALL BE SUITABLY GROUNDED PER NEC 250.

Figure 6


ST. ST. STAINLESS STEEL

CAMERA SCHEDULE				
CAMERA	CAMERA TYPE	CAMERA HOUSING	CAMERA MOUNTING	VIEW LOCATION
1	BasicDome	Indoor	Suspended	1st floor lobby
2	BasicDome	Indoor	Suspended	7-5 th AFF
3	EnviroDome	Outdoor	Pole w/ J-Box	15 th -0 th AFF
4	EnviroDome	Outdoor	Pole w/ J-Box	15 th -0 th AFF
5	EnviroDome	Outdoor	Corner w/ J-Box	8 th -6 th Above Dock
6	EnviroDome	Outdoor	Corner w/ J-Box	14 th -0 th AFF
7	EnviroDome	Outdoor	Corner w/ J-Box	13 th -0 th AFF
8	EnviroDome	Outdoor	Corner w/ J-Box	14 th -6 th AFF
9	EnviroDome	Outdoor	Corner w/ J-Box	14 th -6 th AFF
10	EnviroDome	Outdoor	Corner w/ J-Box	11 th -0 th AFF

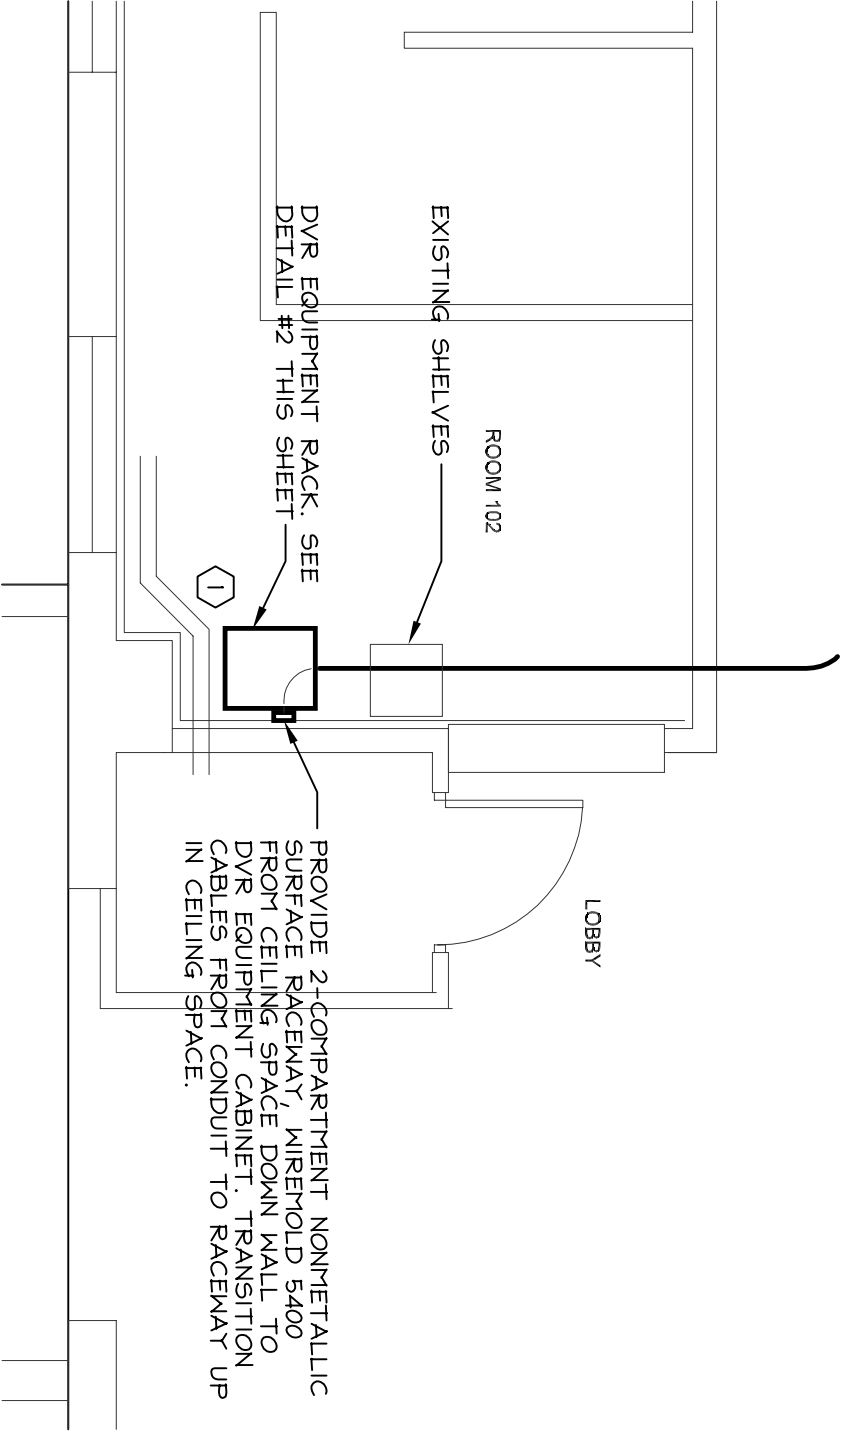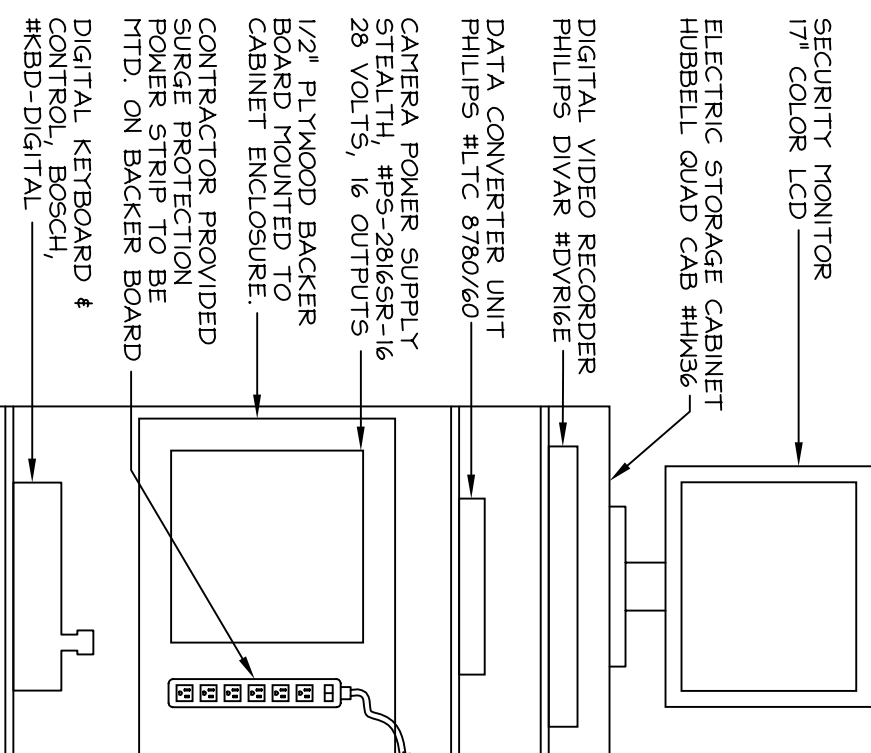


ROOM 102 - DETAIL

SCALE: 1/4" = 1'-0"





DVR EQUIPMENT RACK - DETAIL

NOT TO SCALE

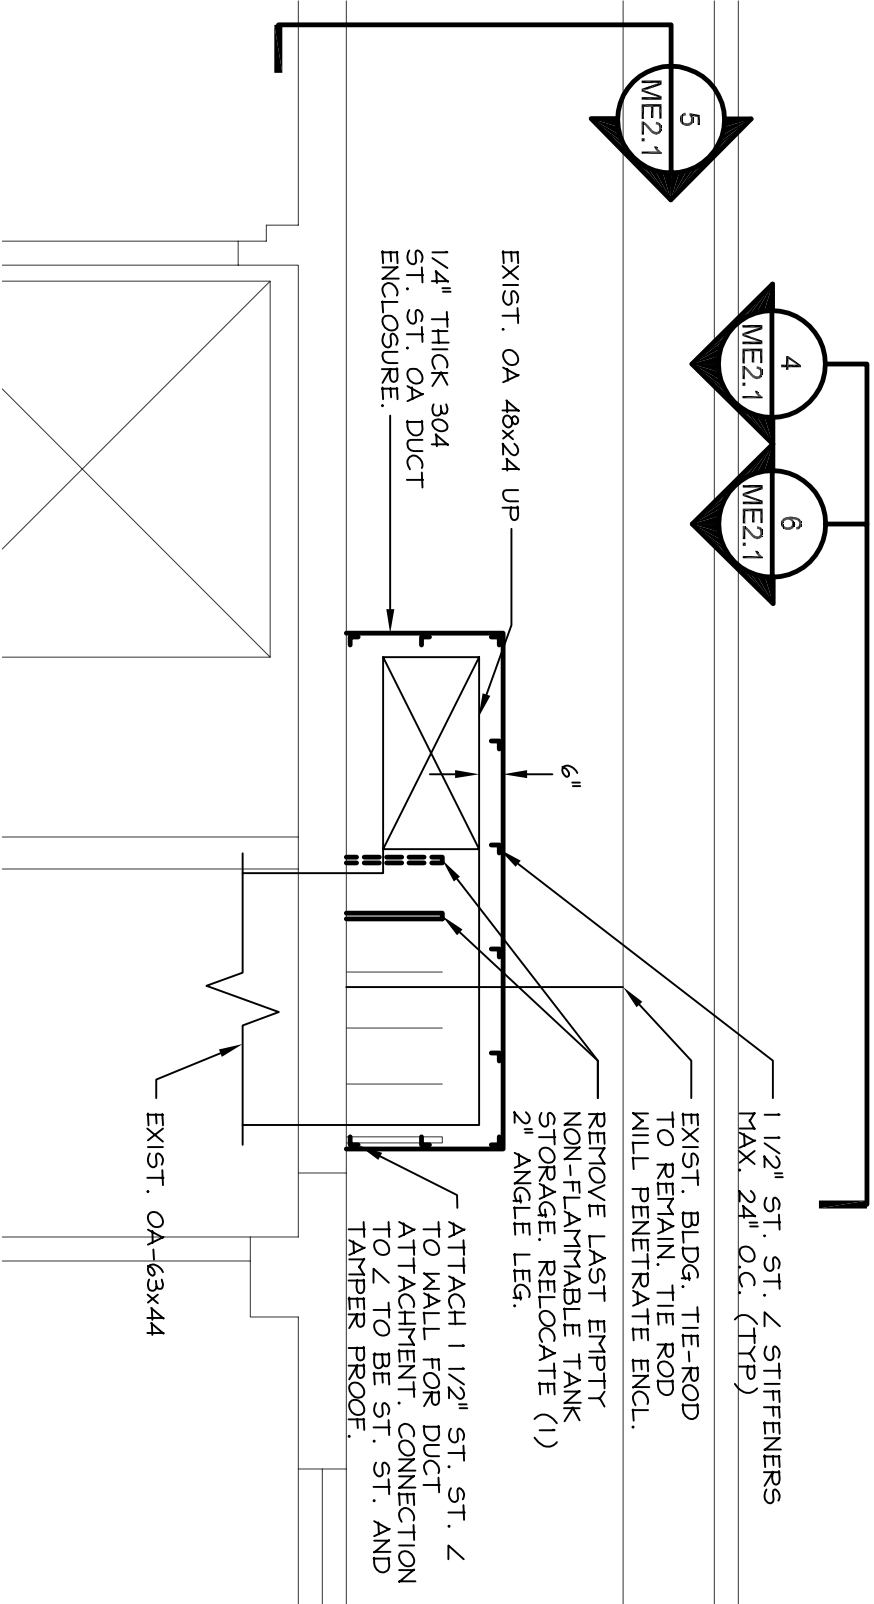


OUTSIDE AIR IN TAKE - PLAIN

SCALE: 1/4" = 1'-0"

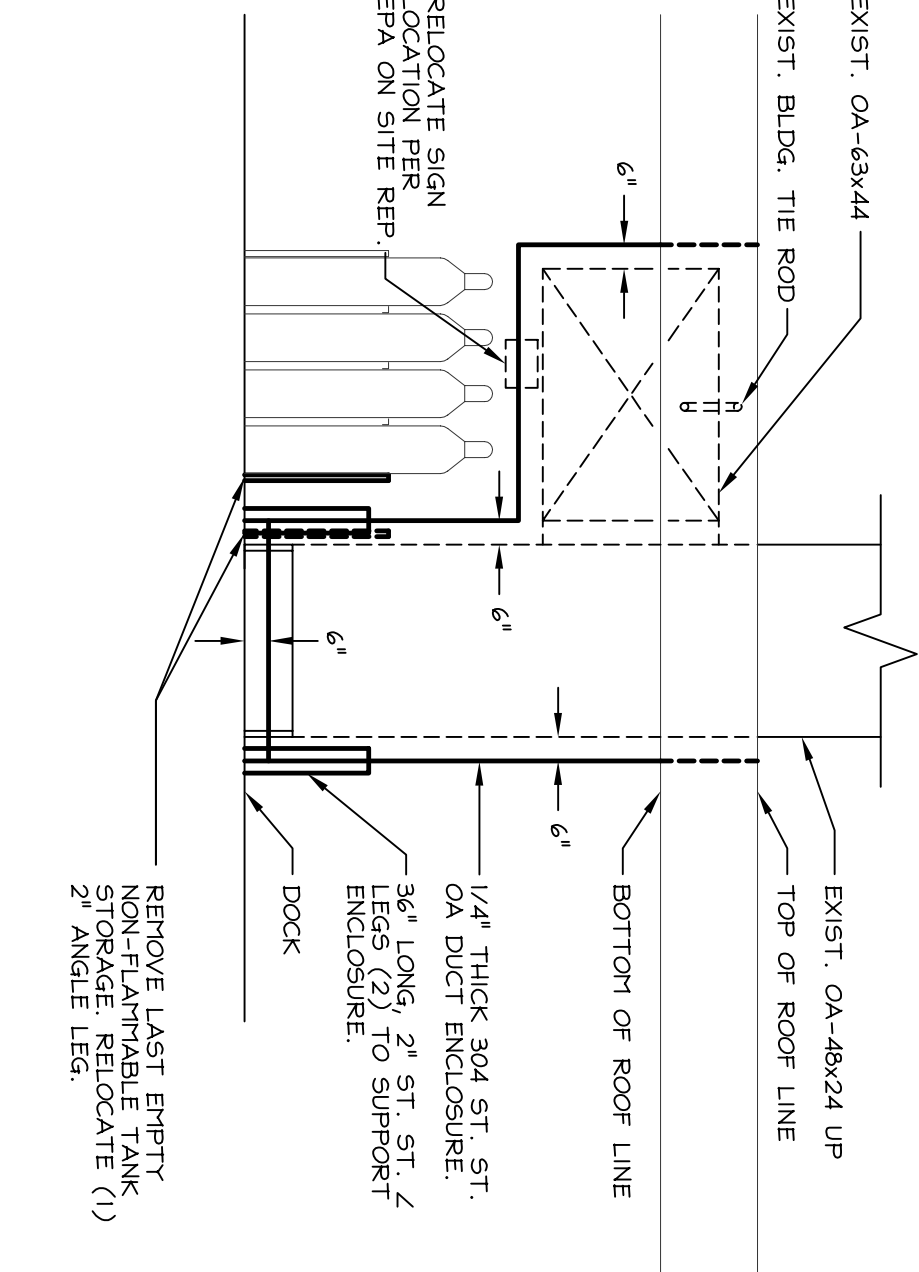


INSIDE AIR IN TAKE - FRONT VIEW

SCALE: 1/4" = 1'-0"

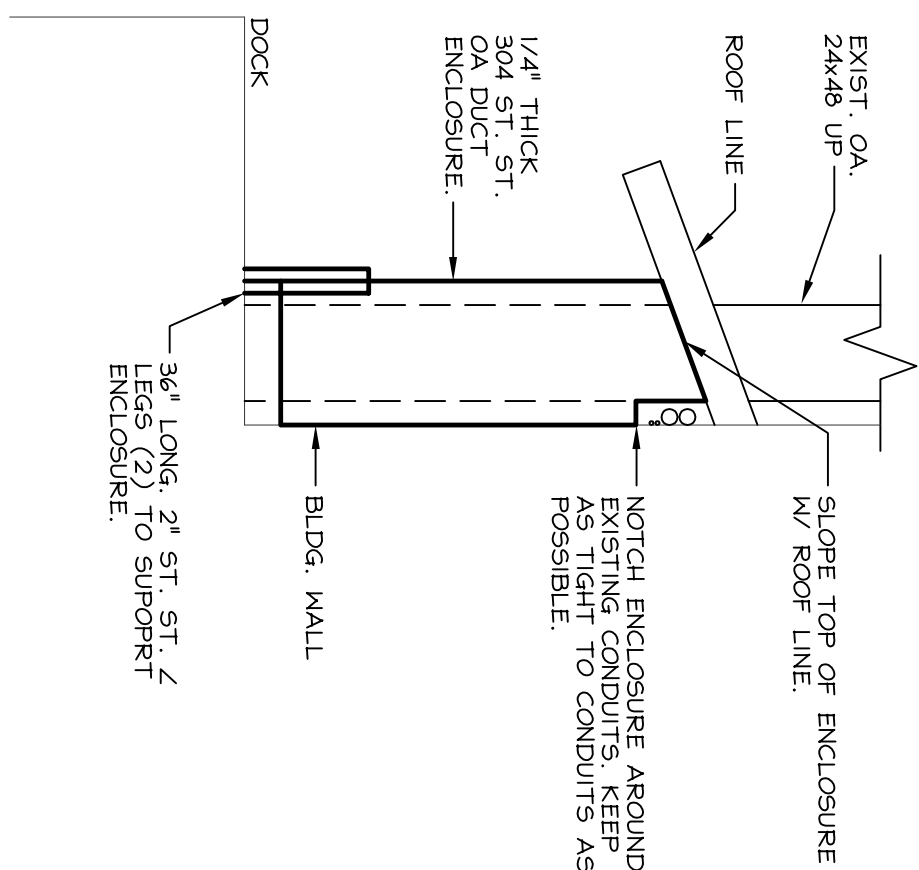



OOISIDE AIR IN LAKE - SIDE VIEW

SCALE: 1/4" = 1'-0"

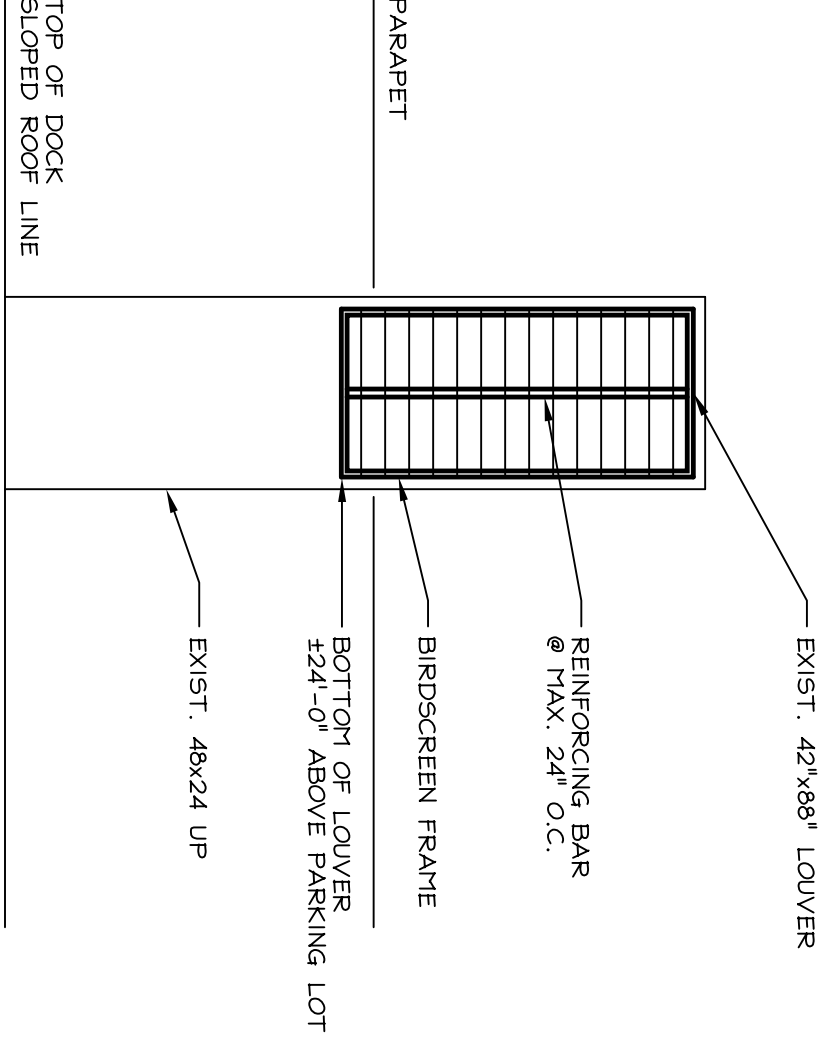

BIRD SCREEN DETAIL - FRONT

SCALE: 1/4" = 1'-0"

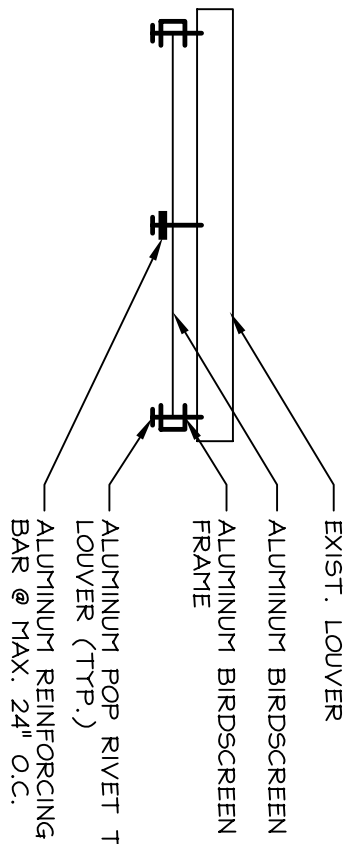

BIRD SCREEN DE IAL

NOT TO SCALE



DRAINING.

1. NEW DVR EQUIPMENT SHALL BE SUITABLY GROUNDED PER NEC 250.

Figure 6

ST. ST. STAINLESS STEEL

